




# 12 Conductor Plenum Data Cable Burn Test

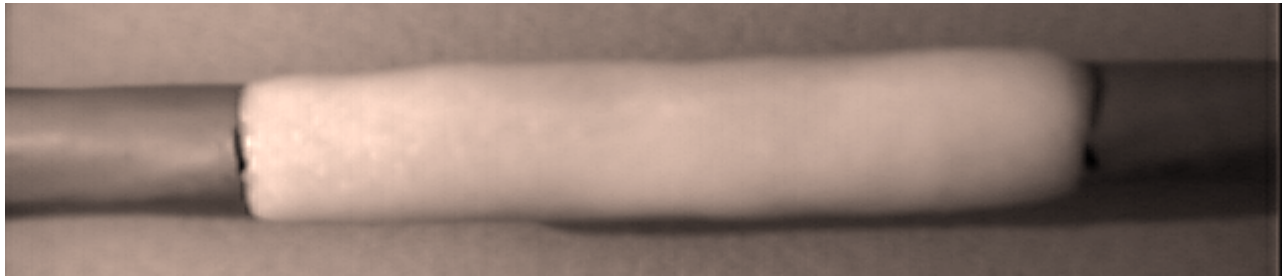


Coated with 0.030" CylaTherm N-30/RTV Silicone (50/50)

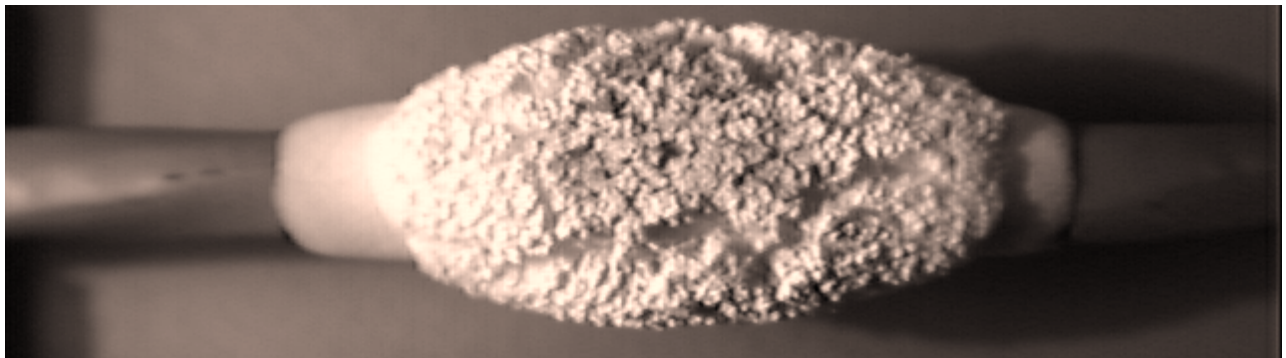

60 second propane/air torch burn

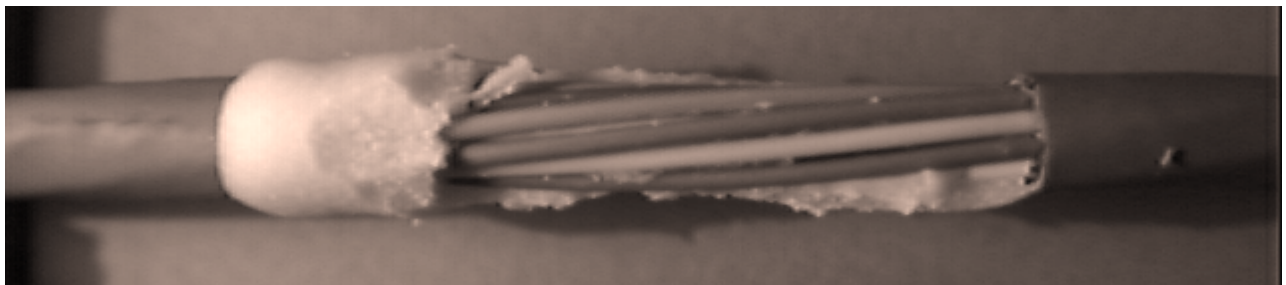

Cutaway of burned coated cable

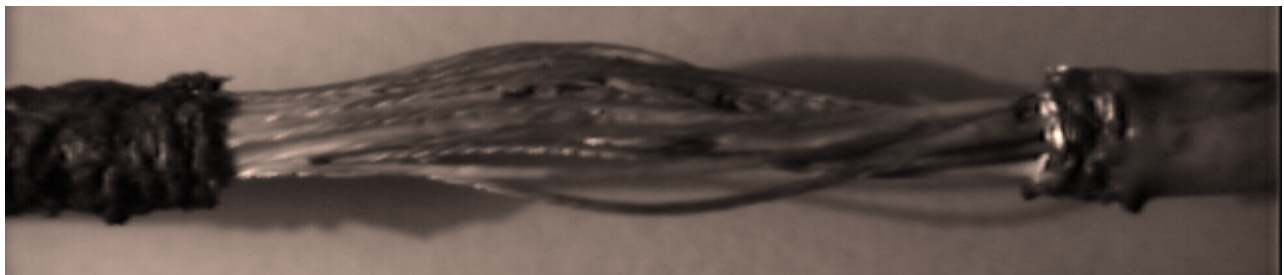

Unprotected cable 60 second propane/air torch burn  
All conductors burned and shorted